

REVISIONS:		
NO.	DATE	DESCRIPTION

TO THE BEST OF THE SIGNING PROFESSIONAL'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES.

THE ENTIRE CONTENTS OF THIS DOCUMENT, INCLUDING ALL SKETCHES, PLANS, STUDIES, DRAWINGS, SCHEDULES AND SPECIFICATIONS, AND ALL COPYRIGHTS THEREIN, ARE AND SHALL REMAIN THE SOLE AND EXCLUSIVE PROPERTY OF DOMINICK R. PILLA ASSOCIATES, P.C. THE DOCUMENTS AND THEIR CONTENTS MAY NOT BE USED, PHOTOCOPIED OR REPRODUCED DIGITALLY, ELECTRONICALLY OR IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF DOMINICK R. PILLA ASSOCIATES, P.C.

PROJECT:
LOCUST GROVE BREWERY
199 N ROAD
MILTON, NY 12547

DETAILS


SEAL AND SIGNATURE:




DOMINICK R. PILLA, P.E., R.A.
NY P.E. 074213-1 NY R.A. 027028-1

ISSUE: FOR PERMIT
DATE: 10/26/2020
PROJECT NO.: 20-059
DRAWN/CHK BY: PH/SM-DRP
SCALE: AS NOTED
DWG NO.:


C-200.00

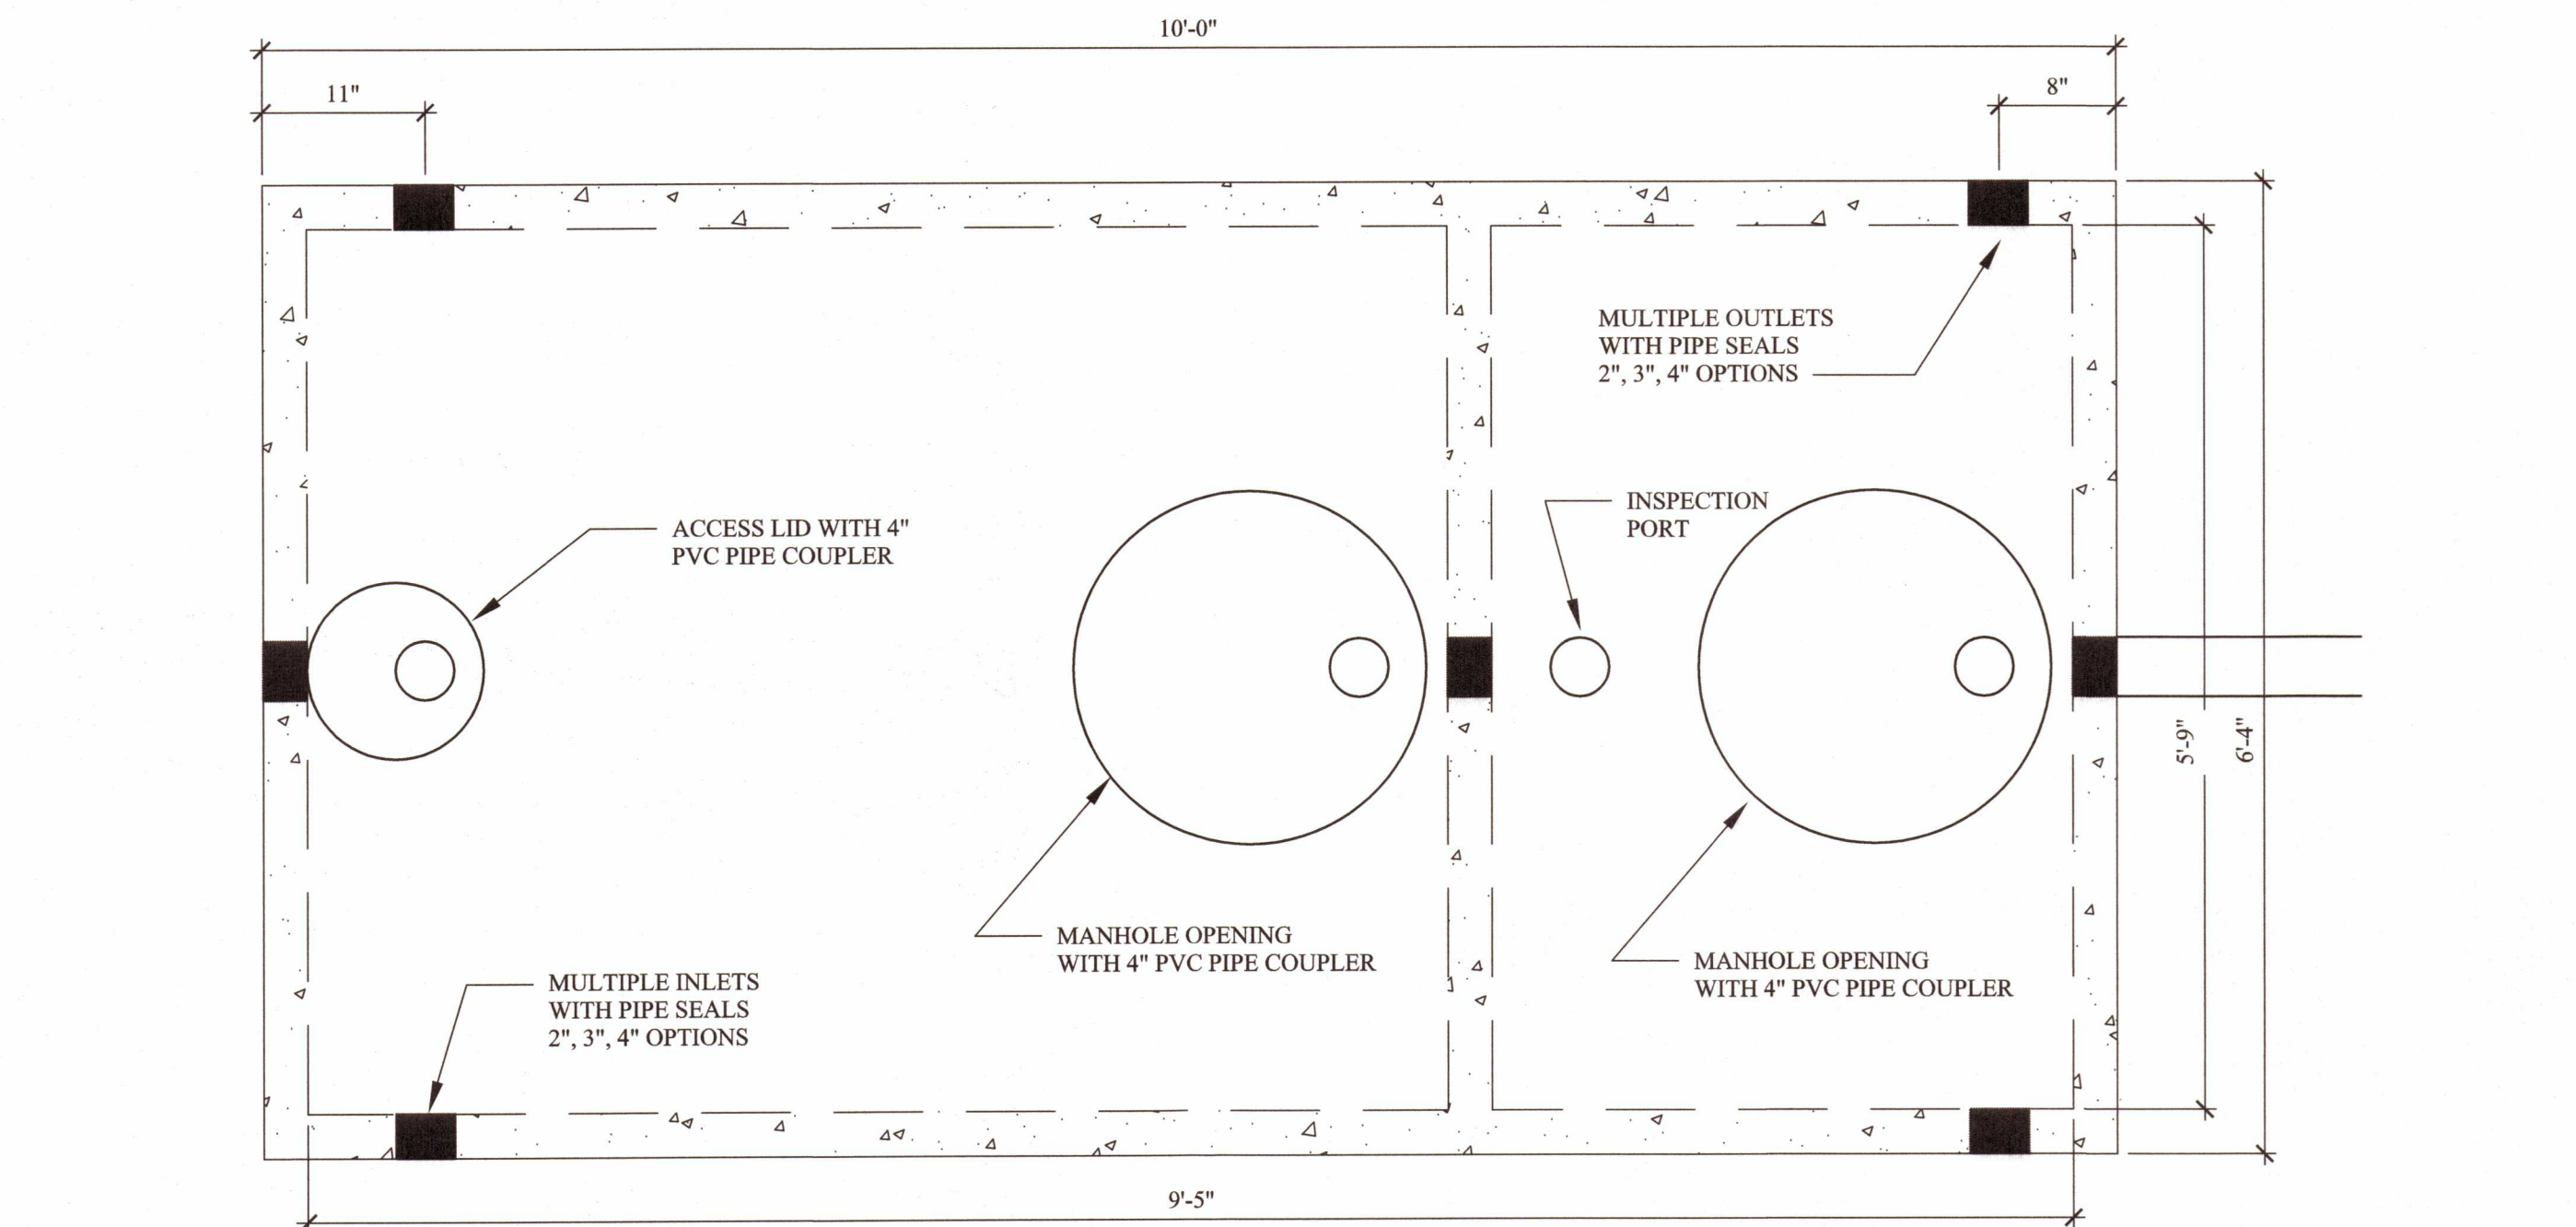


A SEPTIC TANK PLAN VIEW
SCALE : NTS

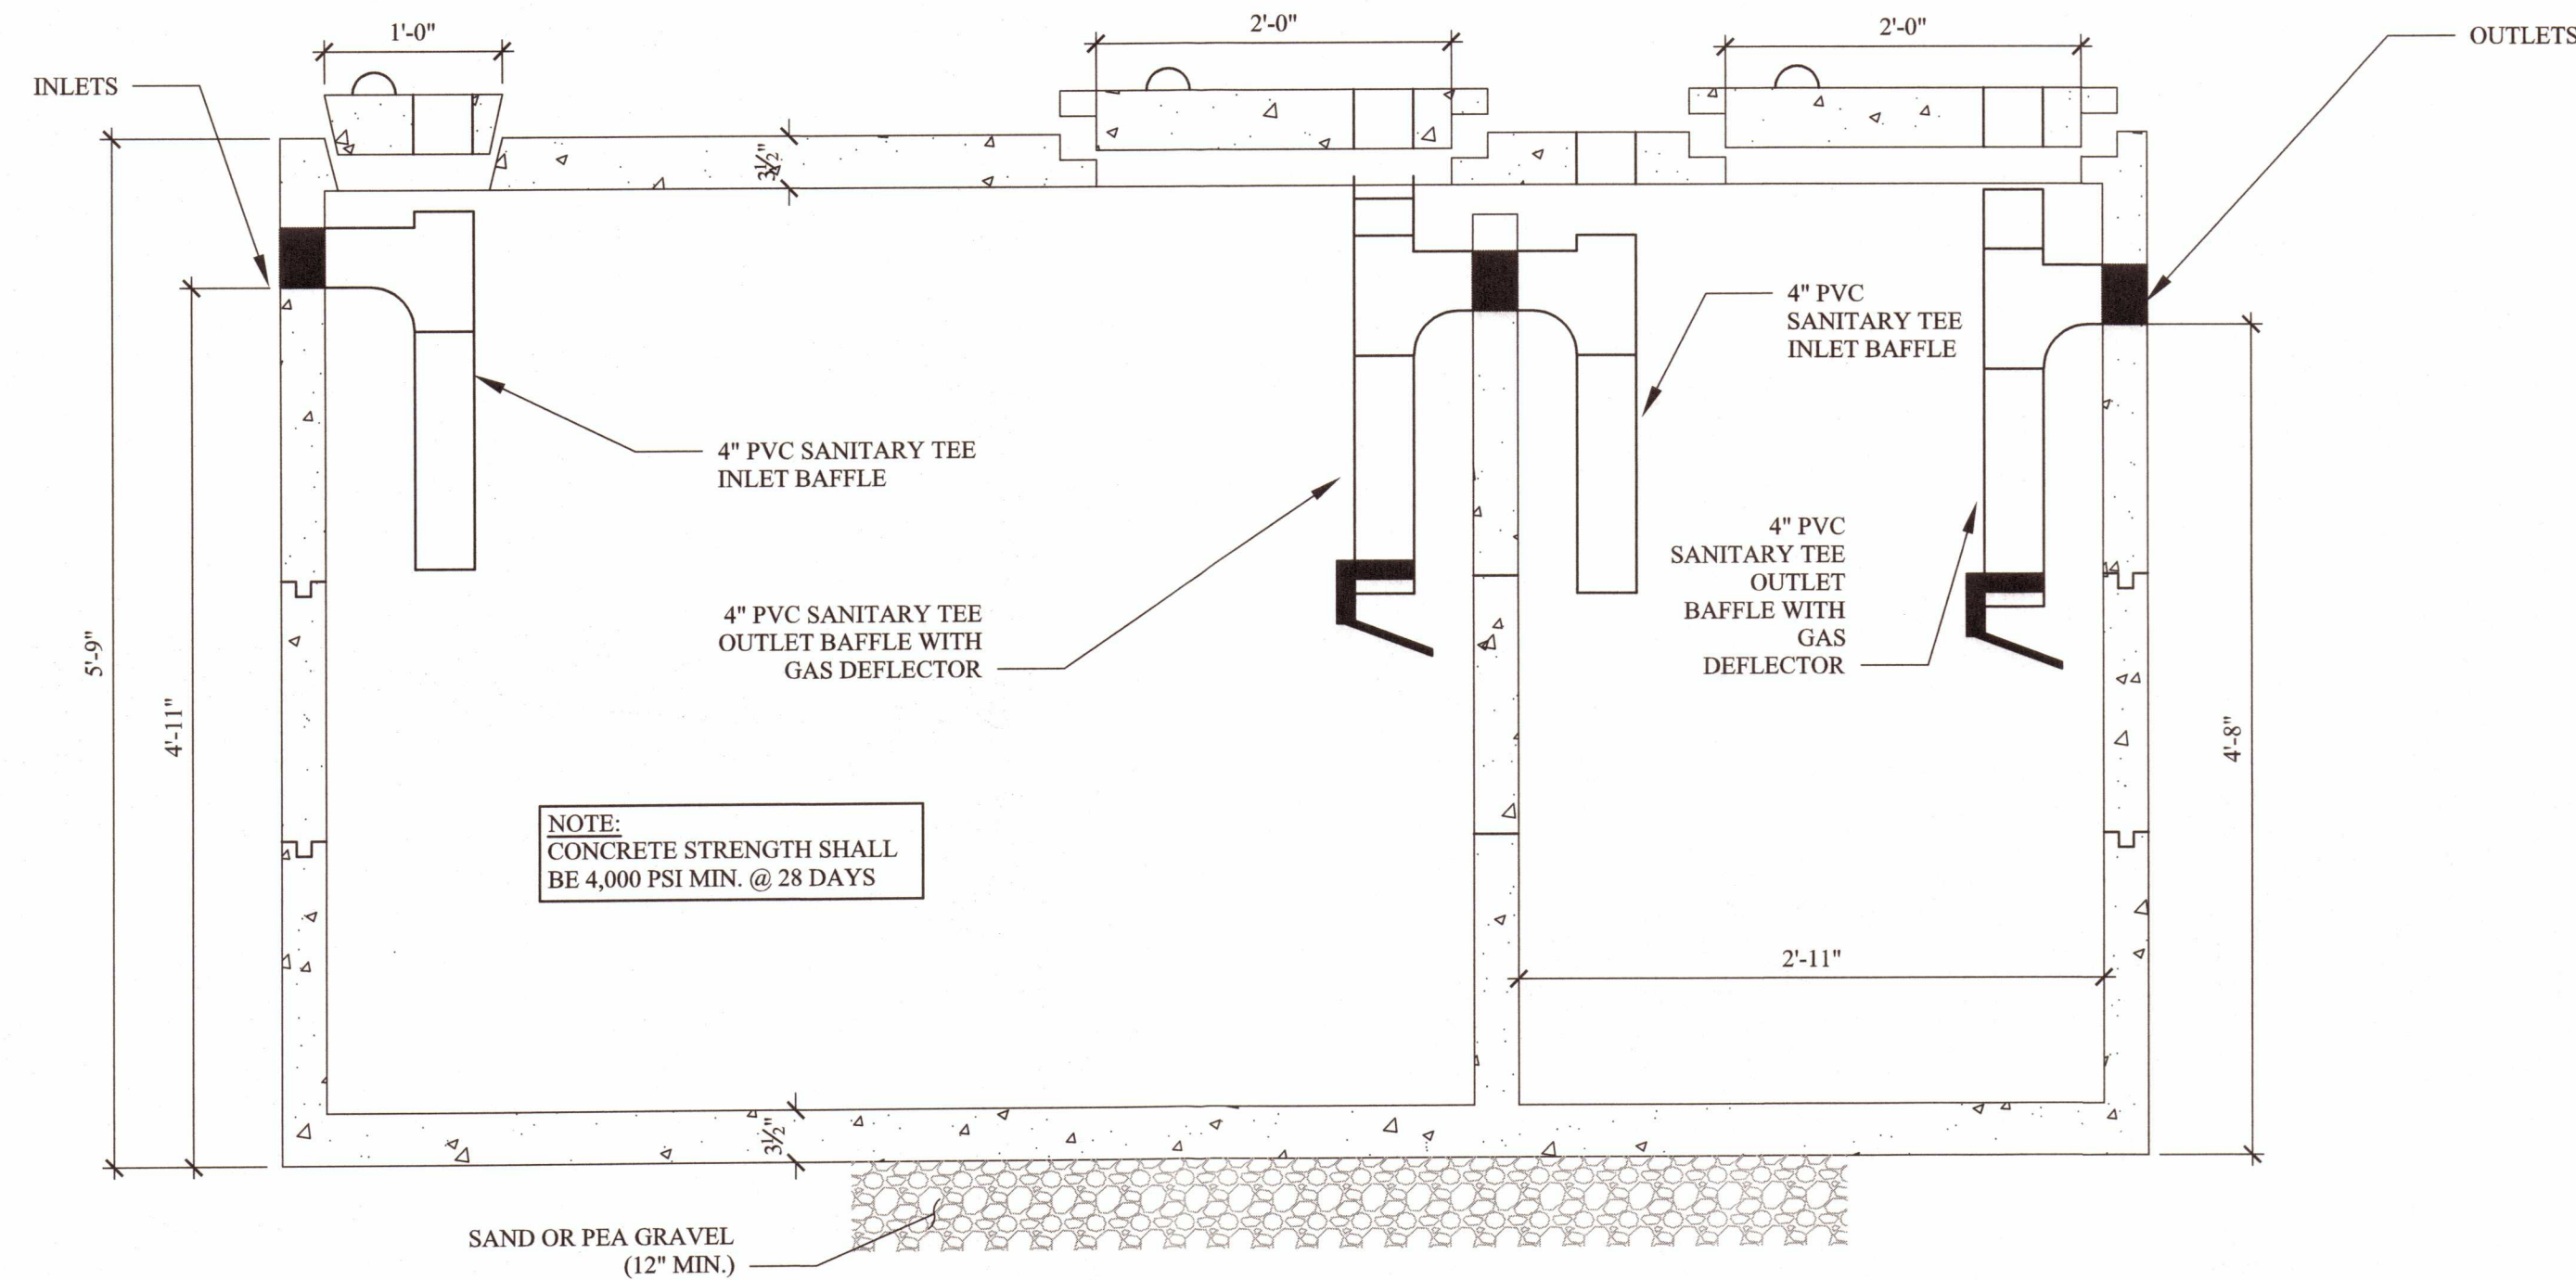

B SEPTIC TANK -SECTION (1,100 GALLON TANK)
SCALE : NTS

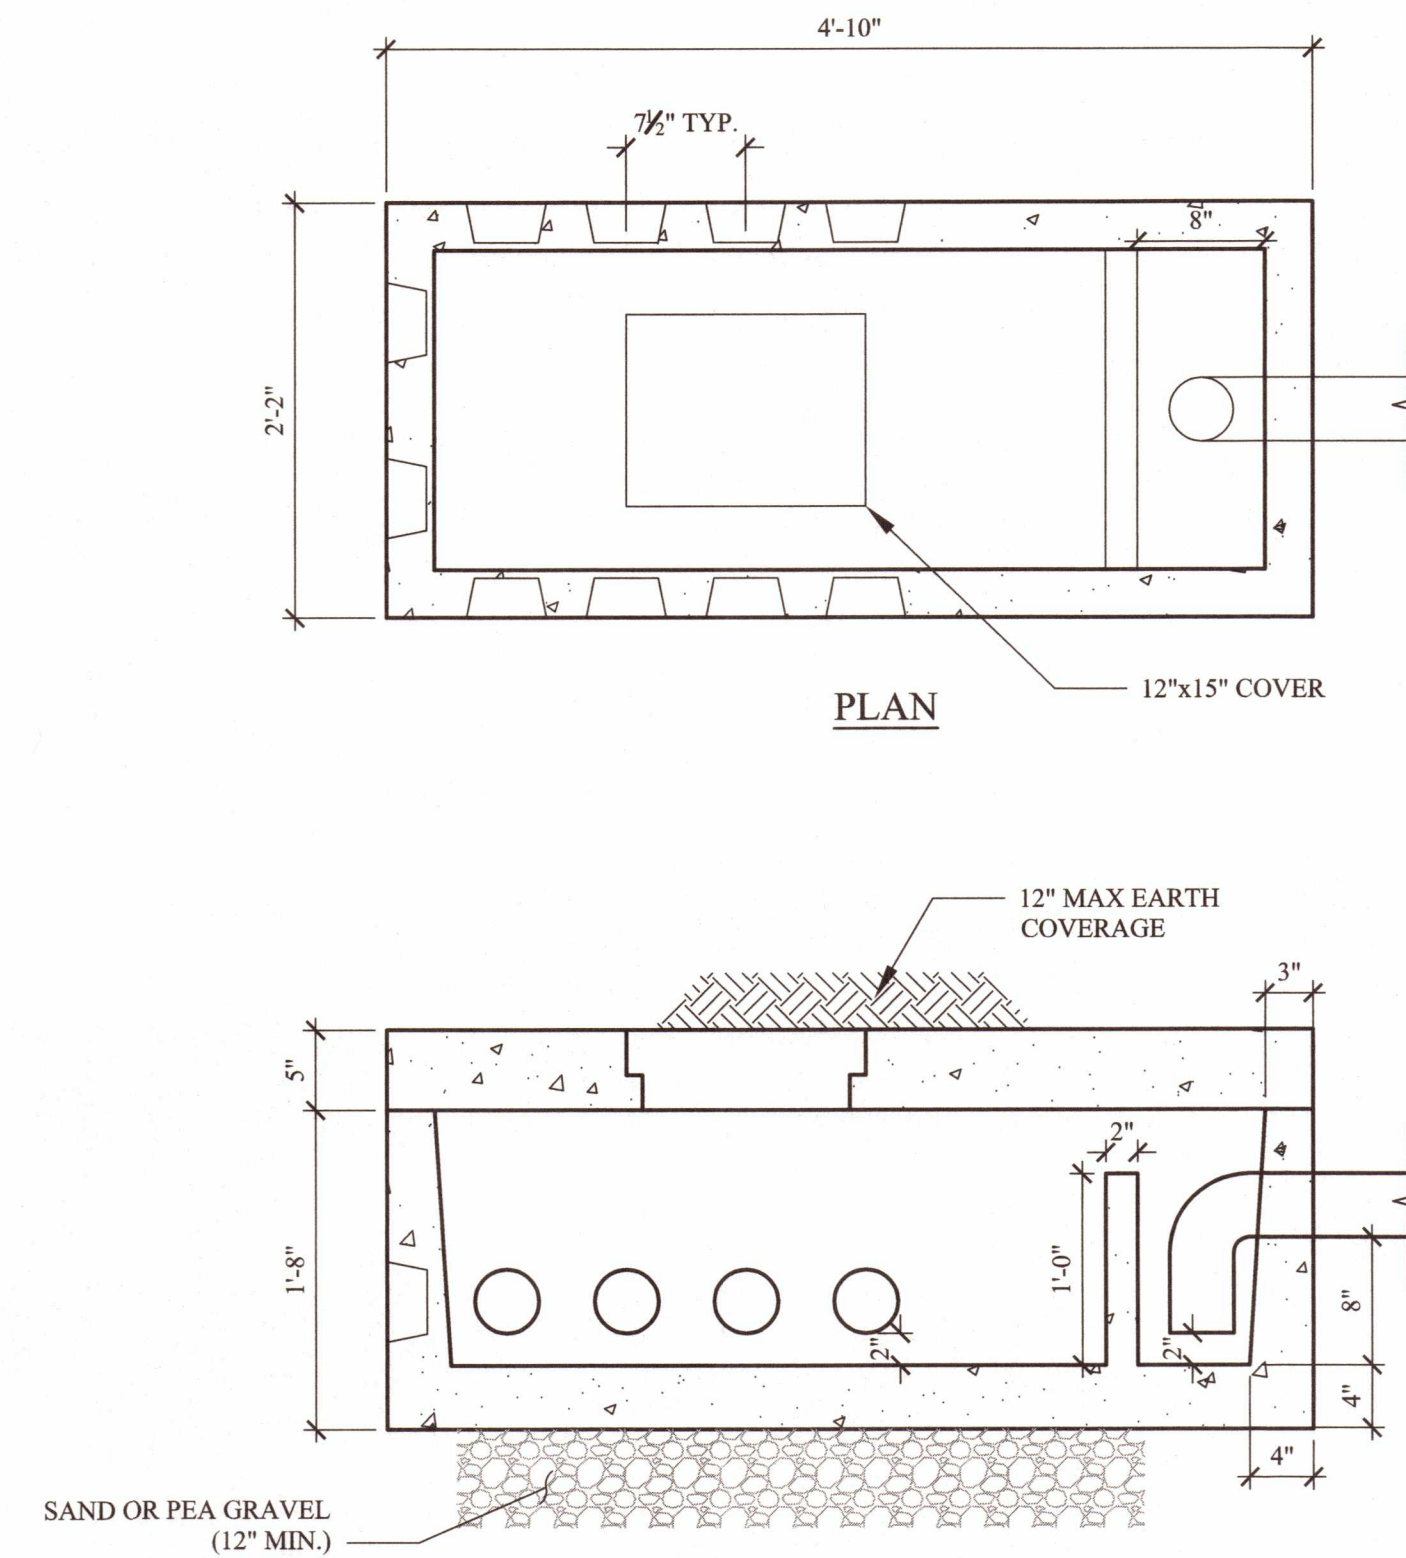

C DISTRIBUTION BOX W/ BAFFLE
SCALE: 1"=1'-0"

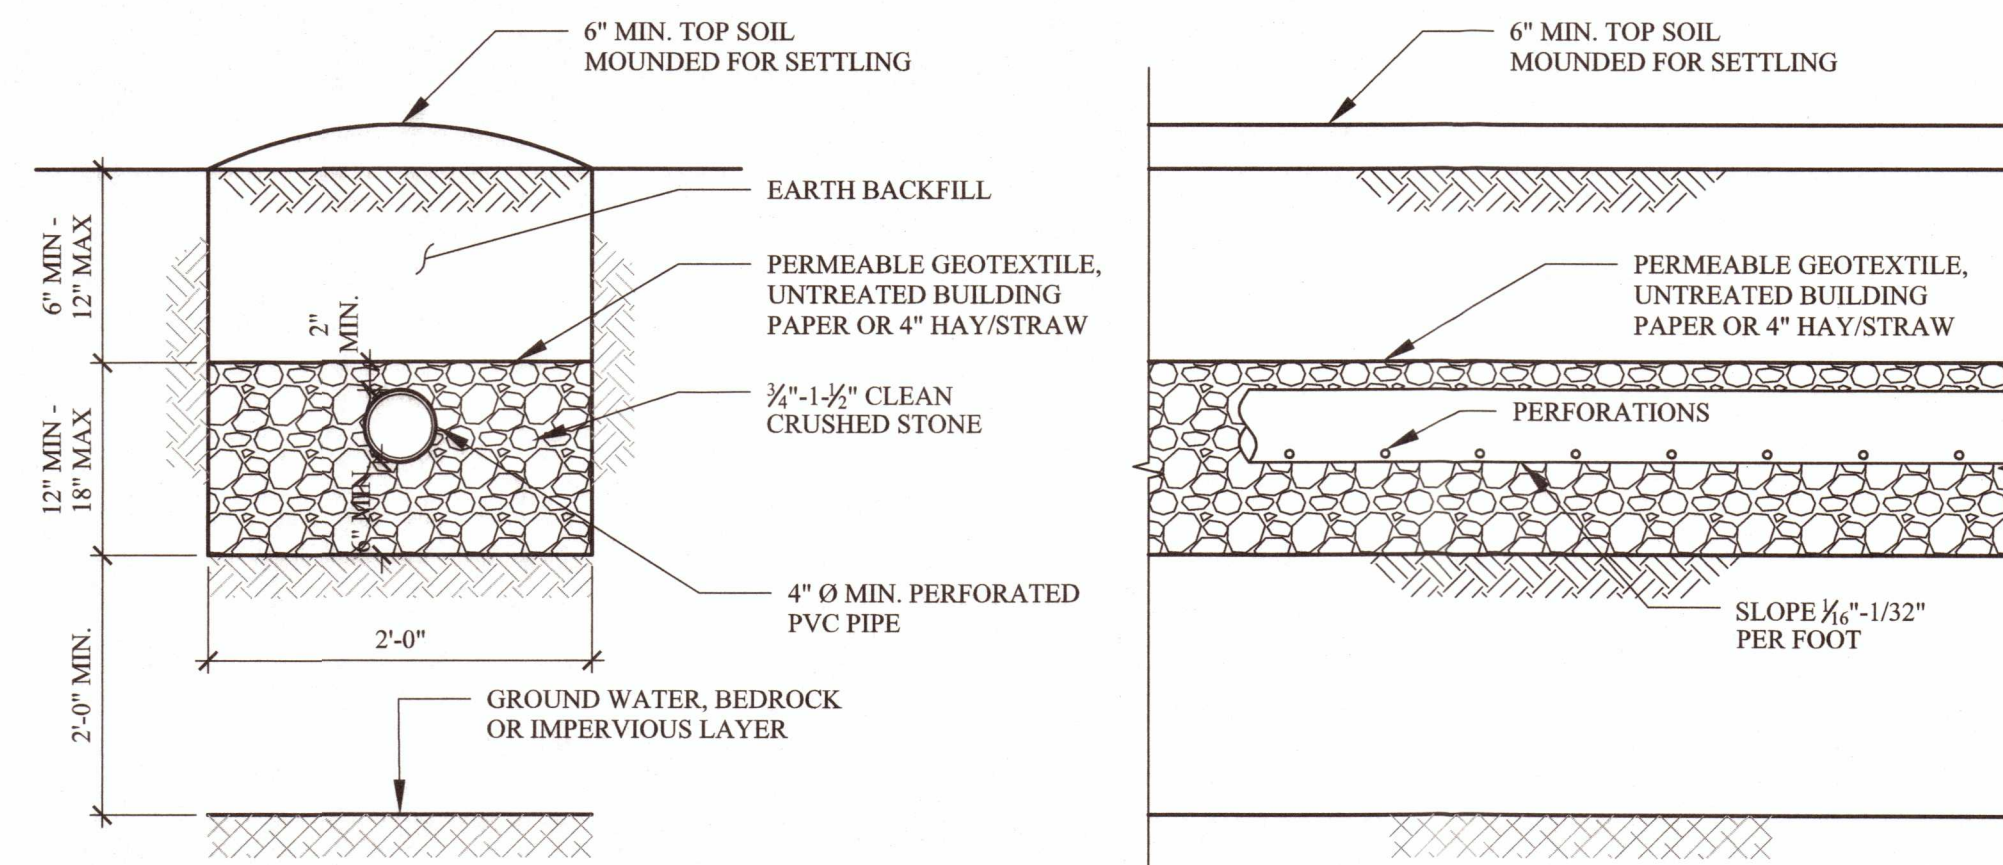

TRANSVERSE SECTION

LONGITUDINAL SECTION

- NOTES:
- DO NOT INSTALL TRENCHES IN WET SOIL
 - INSTALL TRENCHES PARALLEL TO CONTOURS
 - INSTALL TRENCHES AS SHALLOW AS POSSIBLE WHICH MEET ABOVE NOTED MINIMUM DEPTHS
 - RAKE SIDES AND BOTTOM OF TRENCHES PRIOR TO PLACING GRAVEL
 - ENDS OF ALL DISTRIBUTOR PIPES MUST BE CAPPED
 - ABSORPTION TRENCH SPACING 6'-0" O.C. (4'-0" BETWEEN TRENCH SIDEWALLS)
 - MAXIMUM DEPTH OF TRENCHES IS 30 INCHES.

D CONVENTIONAL ABSORPTION TRENCH DETAIL
SCALE: 1"=1'-0"