


Stabilized Construction Entrance

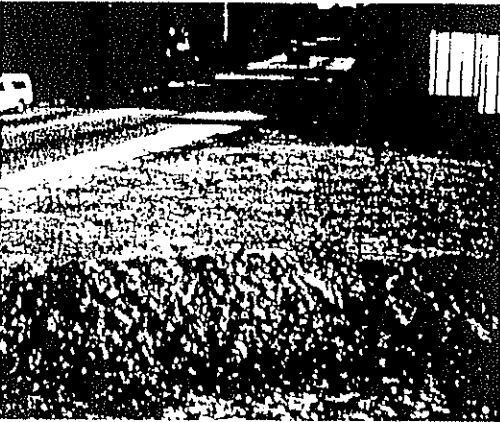

Description

A stabilized pad of aggregate underlain with filter cloth, that is located at all points of construction traffic access to the site to reduce or eliminate the tracking of sediment onto public right-of-ways or streets.

Installation Details

1. Grade entrance by removing sod down to firm subgrade.
2. Place filter cloth over the entrance subgrade.
 - Minimum width - 12 feet
 - Minimum length - 50 feet
3. Construct aggregate pad with positive drainage a minimum of 6 inches thick using 2




inch stone or reclaimed or recycled concrete equivalent.

4. Surface water flowing to the entrance must be piped under the entrance or controlled by a mountable berm to direct flow away from the roadway. The berm shall have slopes no steeper than 5:1.
5. If required, wash stations will be constructed in the same manner with drainage provided to an appropriate sediment trapping device.

Maintenance

- The entrance shall be maintained in a manner that will prevent tracking of sediment into public right-of-ways or streets.
- Inspect all entrances after a rain.
- Periodically top dressing with additional aggregate may be required.
- All sediment and aggregate spilled, dropped, or washed onto public right-of-ways must be removed immediately.
- All sediment shall be prevented from entering storm drains, ditches, or water courses.

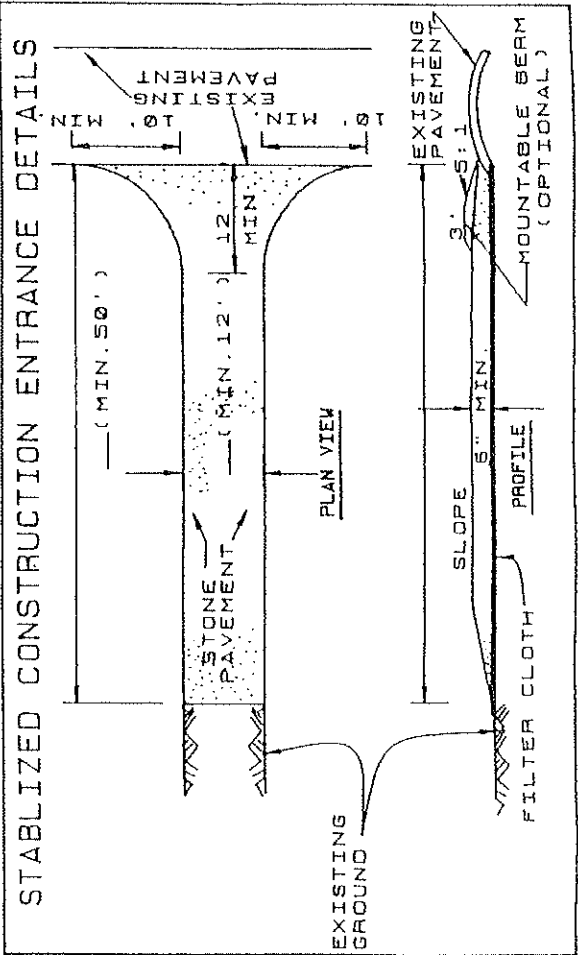

LOCATIONS _____
DATE INSPECTED _____ BY _____

